



Clearance From Slopes

BUILDINGS ADJACENT TO SLOPES >1:3 < 1:1

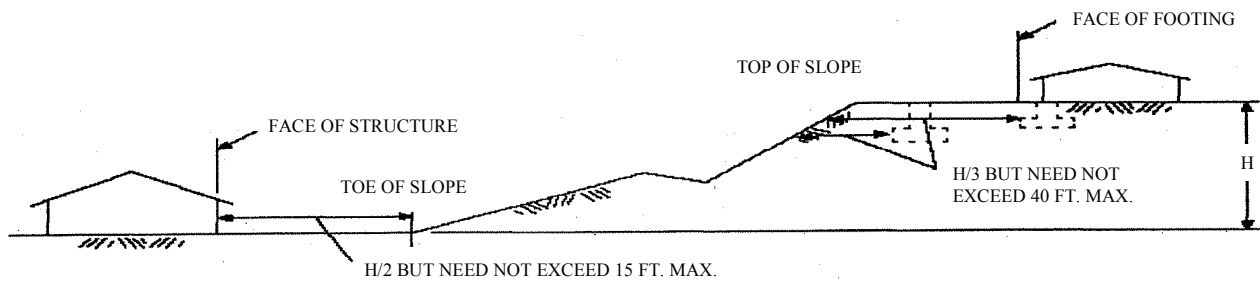

BUILDINGS ADJACENT TO SLOPES > 1:1

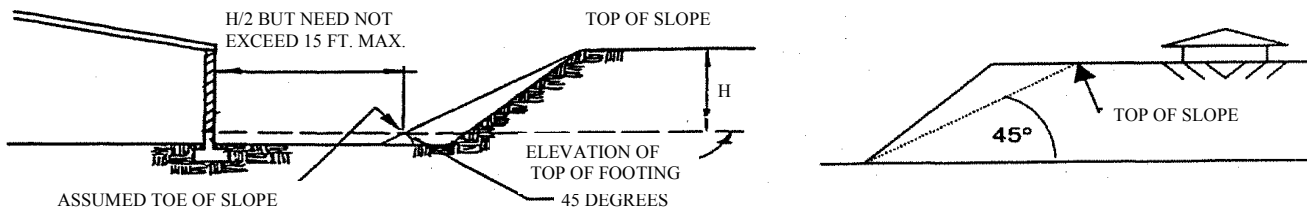

DESCENDING


ASCENDING

1805.3 & R403.1.7 Footings on or adjacent to slopes. The placement of buildings and structures on or adjacent to slopes steeper than 1 unit vertical in 3 units horizontal (33.3-percent slope) shall conform to Sections R403.1.7.1 through R403.1.7.4.

1805.3.1 & R403.1.7.1 Building clearances from ascending slopes. In general, buildings below slopes shall be set a sufficient distance from the slope to provide protection from slope drainage, erosion and shallow failures. Except as provided in Section R403.1.7.4 and Figure R403.1.7.1, the following criteria will be assumed to provide this protection. Where the existing slope is steeper than one unit vertical in one unit horizontal (100-percent slope), the toe of the slope shall be assumed to be at the intersection of a horizontal plane drawn from the top of the foundation, and a plane drawn tangent to the slope at an angle of 45 degrees (0.79 rad) to the horizontal. Where a retaining wall is constructed at the toe of the slope, the height of the slope shall be measured from the top of the wall to the top of the slope.

1805.3.2 & R403.1.7.2 Footing setback from descending slope surfaces. Footings on or adjacent to slope surfaces shall be founded in material with an embedment and setback from the slope surface sufficient to provide vertical and lateral support for the footing without detrimental settlement. Except as provided for in Section R403.1.7.4 and Figure R403.1.7.1, the following setback is deemed adequate to meet the criteria. Where the slope is steeper than one unit vertical in one unit horizontal (100-percent slope), the required setback shall be measured from an imaginary plane 45 degrees (0.79 rad) to the horizontal, projected upward from the toe of the slope.

1805.3.5 & R403.1.7.4 Alternate setback and clearances. Alternate setbacks and clearances are permitted, subject to the approval of the building official. The building official is permitted to require an investigation and recommendation of a qualified engineer to demonstrate that the intent of this section has been satisfied. Such an investigation shall include consideration of material, height of slope, slope gradient, load intensity and erosion characteristics of slope material.

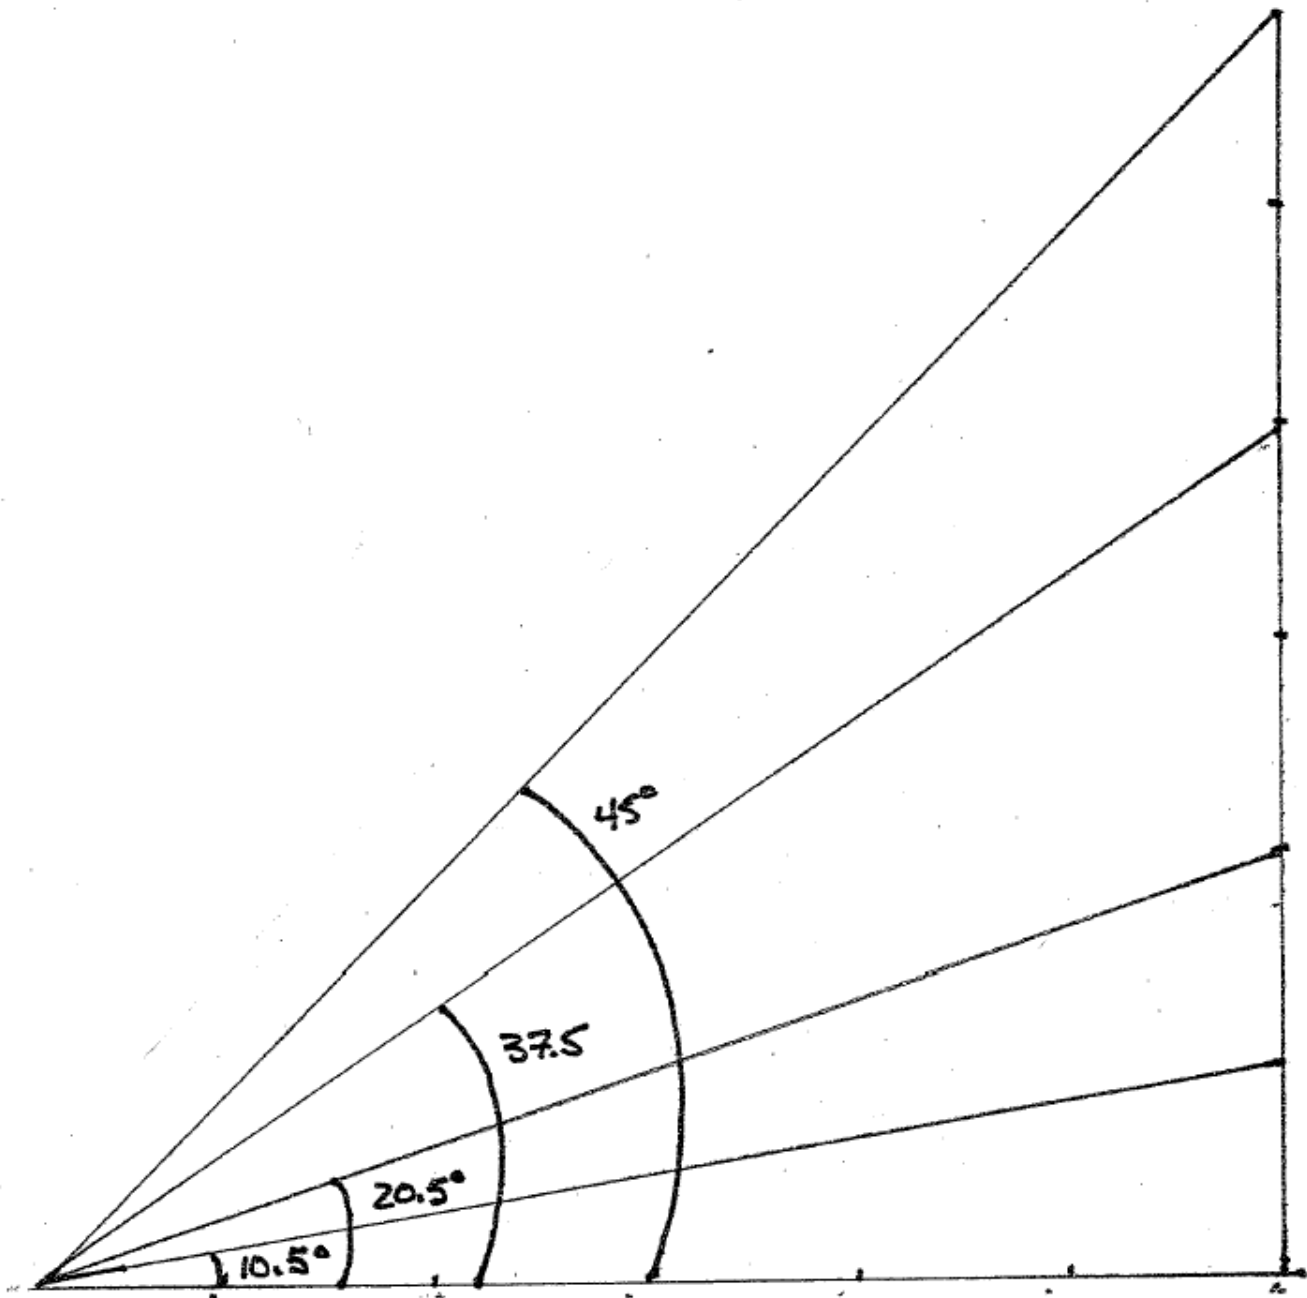

Ratio	Angle (Degree)	Percent (of Grade)	Pitch (in Inches)
1:1 [3:3]	45°	100%	12:12
2:3	37.5°	66.7%	8:12
1:3	20.5°	33.3%	4:12
½:3	10.5°	16.6%	2:12
.425:3	9°	14%	1.7:12
.35:3	8°	12%	1.4:12

Grays Harbor County
Planning & Building Division
 Public Services Department
 100 W Broadway Suite 31
 Montesano, WA 98563
 360-249-5579
 360-249-3203 (fax)



pbd@co.grays-harbor.wa.us